
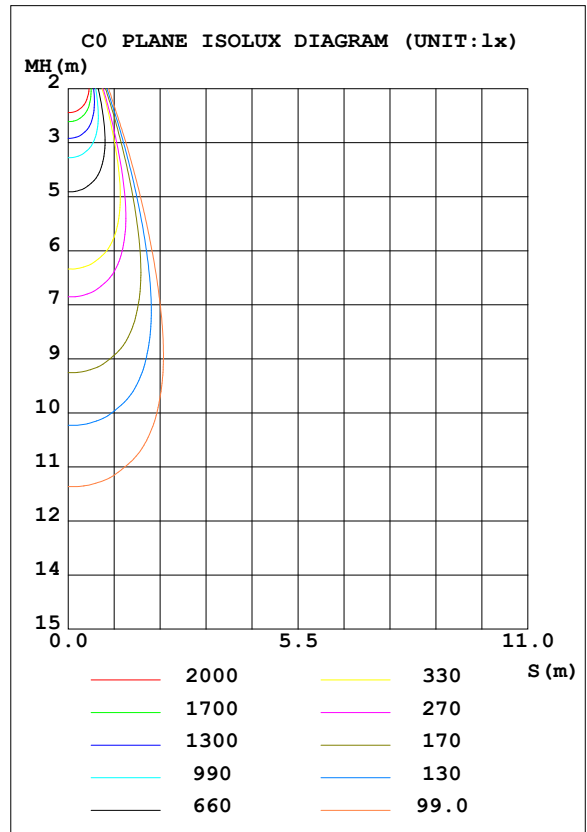


**LUMINAIRE PHOTOMETRIC TEST REPORT**

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

DATA OF LAMP		PHOTOMETRIC DATA Eff: 129.72 lm/W			
MODEL	CITIZEN-3000K	I <sub>max</sub> (cd)	13251	S/MH (C0/180)	0.44
NOMINAL POWER (W)	28	LOR (%)	100.0	S/MH (C90/270)	0.45
RATED VOLTAGE (V)	220	TOTAL FLUX (lm)	3487.9	η UP, DN (C0-180)	0.0, 52.6
NOMINAL FLUX (lm)	3487.93	CIE CLASS	DIRECT	η UP, DN (C180-360)	0.0, 47.4
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.00
TEST VOLTAGE (V)	220	η down (%)	100.0	CIBSE SHR MAX	1.00

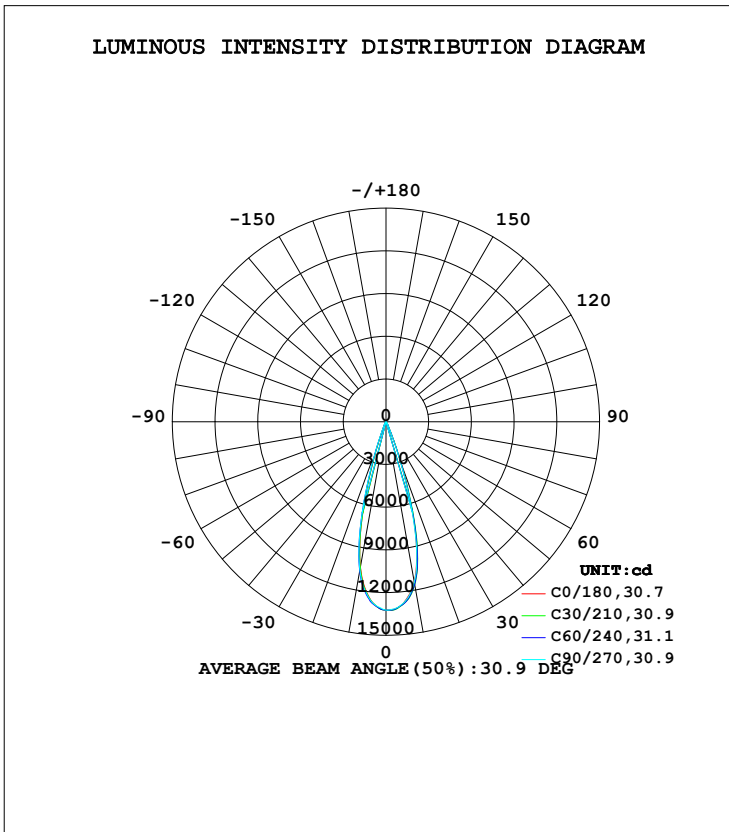

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature: 25.3DEG  
 Operators: Jasoan  
 Test Date: 2023-08-18

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
 Humidity: 58%  
 Test Distance: 8.967m [K=1.0000]  
 Remarks:

**ZONAL FLUX DIAGRAM**

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1142	1162	1145	1064	1035	1053	1060	1103	0- 10	1160	1160	33.2,33.2
20	299.4	309.2	286.9	198.0	163.7	172.8	188.3	253.4	10- 20	1801	2961	84.9,84.9
30	29.38	28.76	29.74	26.60	23.77	24.17	25.29	28.30	20- 30	344.3	3305	94.8,94.8
40	10.99	11.17	11.65	11.13	10.45	10.27	10.70	10.91	30- 40	107.0	3412	97.8,97.8
50	3.500	3.587	3.911	3.892	3.766	3.718	3.716	3.742	40- 50	52.56	3464	99.3,99.3
60	0.6619	0.6353	0.7573	0.8244	0.8353	0.8608	0.8410	0.8148	50- 60	17.72	3482	99.8,99.8
70	0.2003	0.1886	0.2268	0.2514	0.2500	0.2529	0.2525	0.2499	60- 70	4.645	3487	100,100
80	0.0240	0.0199	0.0195	0.0208	0.0196	0.0178	0.0191	0.0202	70- 80	1.069	3488	100,100
90	0.0130	0.0128	0.0131	0.0131	0.0120	0.0120	0.0120	0.0120	80- 90	0.1582	3488	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:×10cd									UNIT:lm		

Conical surface Flux(90deg): 3443.8 lm

%lum = 98.7%

%lamp = 98.7%

Conical surface Flux(120deg): 3482.1 lm

%lum = 99.8%


%lamp = 99.8%

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jasoan  
Test Date:2023-08-18

γ Range: 0 - 90DEG  
γ Interval: 0.5DEG  
Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
Humidity:58%  
Test Distance:8.967m [K=1.0000]  
Remarks:

**LUMINANCE LIMITATION CURVES**

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

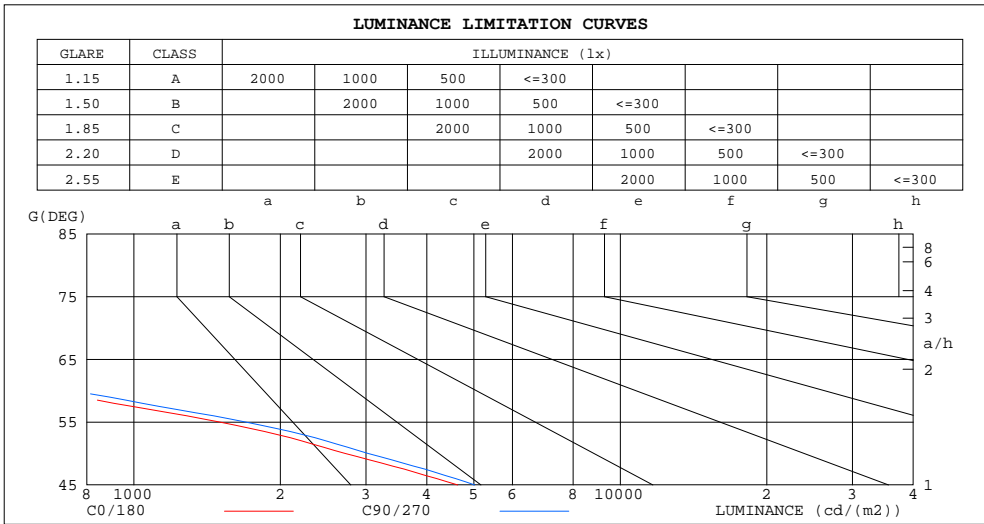

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	90	78
80	69	56
75	160	181
70	292	330
65	454	514
60	660	754
55	1500	1697
50	2716	3028
45	4631	5018


C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2023-08-18

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
 Humidity:58%  
 Test Distance:8.967m [K=1.0000]  
 Remarks:

**CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM**

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															
	Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.13	1.11	1.09	1.11	1.09	1.08	1.07	1.05	1.04	1.03	1.02	1.01	.00	.99	.98	.97
2.0	1.08	1.05	1.02	1.06	1.03	1.01	1.03	1.01	.99	1.00	.98	.97	.97	.96	.95	.93
3.0	1.03	.00	.97	1.02	.99	.96	.99	.97	.94	.97	.95	.93	.95	.93	.92	.90
4.0	.99	.95	.92	.98	.94	.92	.96	.93	.91	.94	.92	.90	.93	.90	.89	.87
5.0	.96	.91	.88	.95	.91	.88	.93	.90	.87	.92	.89	.87	.90	.88	.86	.85
6.0	.92	.88	.85	.92	.88	.85	.90	.87	.84	.89	.86	.84	.88	.85	.83	.82
7.0	.89	.85	.82	.89	.85	.82	.88	.84	.82	.87	.84	.81	.86	.83	.81	.80
8.0	.87	.83	.80	.86	.82	.80	.85	.82	.79	.84	.81	.79	.84	.81	.79	.78
9.0	.84	.80	.77	.84	.80	.77	.83	.79	.77	.82	.79	.77	.81	.79	.77	.76
10.0	.82	.78	.75	.81	.78	.75	.81	.77	.75	.80	.77	.75	.80	.77	.75	.74

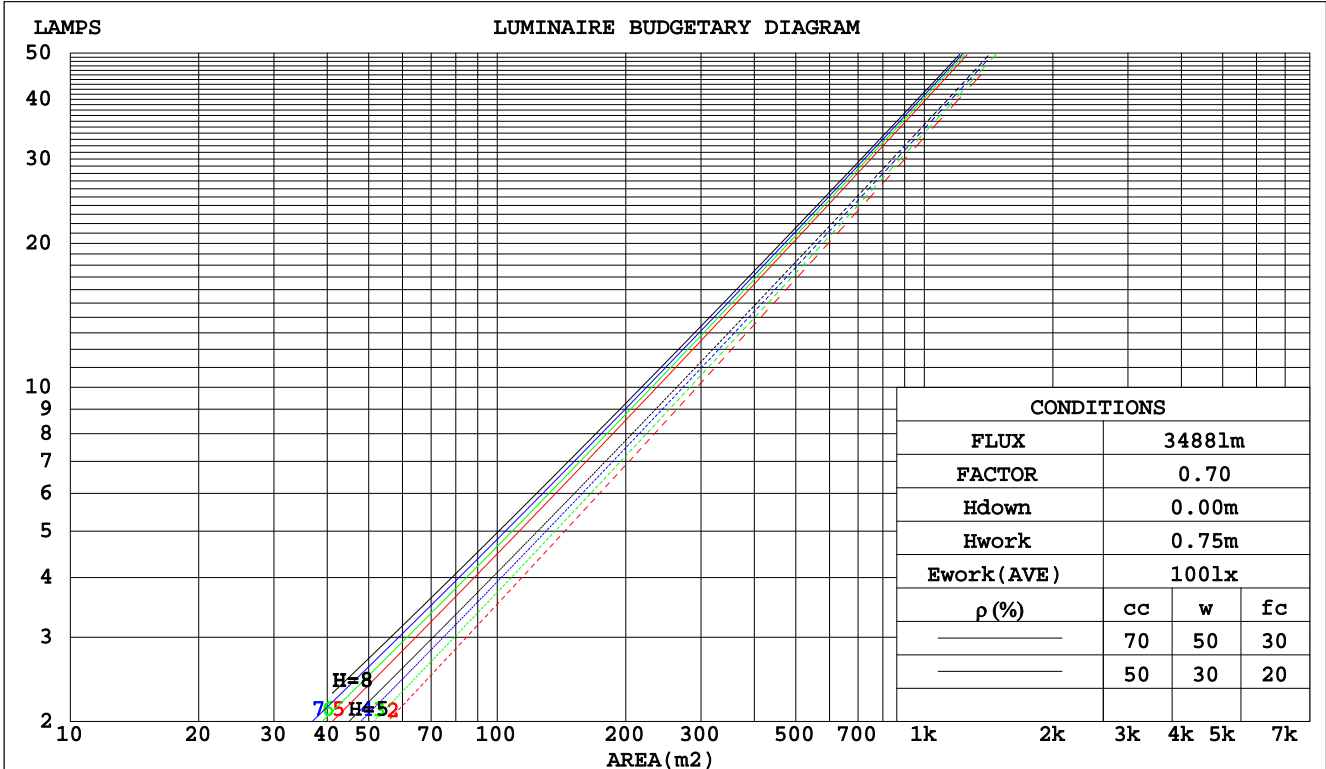

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2023-08-18

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
 Humidity:58%  
 Test Distance:8.967m [K=1.0000]  
 Remarks:

WEC AND CCEC

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.137	.078	.025	.130	.074	.024	.117	.067	.022	.106	.061	.020	.096	.055	.018	
2.0	.126	.069	.021	.121	.067	.021	.111	.062	.019	.101	.057	.018	.093	.052	.017	
3.0	.118	.063	.019	.113	.061	.018	.105	.057	.017	.097	.053	.016	.090	.050	.015	
4.0	.110	.057	.017	.107	.056	.016	.099	.053	.016	.093	.050	.015	.087	.047	.014	
5.0	.104	.053	.015	.101	.052	.015	.095	.049	.015	.089	.047	.014	.084	.045	.013	
6.0	.098	.049	.014	.096	.048	.014	.090	.046	.013	.085	.044	.013	.081	.043	.013	
7.0	.093	.046	.013	.091	.045	.013	.086	.044	.013	.082	.042	.012	.078	.041	.012	
8.0	.089	.043	.012	.087	.043	.012	.083	.041	.012	.079	.040	.012	.076	.039	.011	
9.0	.085	.041	.011	.083	.041	.011	.080	.039	.011	.076	.038	.011	.073	.037	.011	
10.0	.082	.039	.011	.080	.039	.011	.077	.038	.011	.074	.037	.010	.071	.036	.010	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.168	.158	.148	.144	.135	.127	.099	.093	.088	.057	.054	.051	.018	.017	.017	
2.0	.150	.133	.118	.129	.114	.102	.088	.079	.071	.051	.046	.042	.016	.015	.014	
3.0	.135	.113	.096	.116	.098	.083	.080	.068	.058	.046	.040	.034	.015	.013	.011	
4.0	.123	.098	.079	.105	.085	.069	.072	.059	.048	.042	.035	.029	.013	.011	.009	
5.0	.112	.086	.066	.096	.074	.057	.066	.052	.041	.038	.030	.024	.012	.010	.008	
6.0	.103	.076	.056	.089	.065	.049	.061	.046	.034	.036	.027	.020	.011	.009	.007	
7.0	.096	.067	.048	.082	.058	.041	.057	.041	.029	.033	.024	.017	.011	.008	.006	
8.0	.089	.061	.041	.077	.053	.036	.053	.037	.025	.031	.022	.015	.010	.007	.005	
9.0	.083	.055	.036	.072	.048	.031	.050	.034	.022	.029	.020	.013	.009	.006	.004	
10.0	.079	.050	.031	.068	.044	.027	.047	.031	.019	.027	.018	.012	.009	.006	.004	

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2023-08-18

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
 Humidity:58%  
 Test Distance:8.967m [K=1.0000]  
 Remarks:

UGR(Unified Glare Rating) Table

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	6.9	7.6	7.1	7.7	7.9	7.1	7.8	7.3	7.9	8.1
3H	6.8	7.4	7.0	7.6	7.8	7.0	7.6	7.3	7.8	8.0
4H	6.7	7.3	7.0	7.5	7.7	7.0	7.5	7.2	7.7	8.0
6H	6.6	7.2	6.9	7.4	7.7	6.9	7.4	7.2	7.7	7.9
8H	6.6	7.1	6.9	7.4	7.6	6.8	7.4	7.1	7.6	7.9
12H	6.6	7.1	6.9	7.3	7.6	6.8	7.3	7.1	7.6	7.8
4H 2H	6.7	7.3	7.0	7.5	7.7	7.0	7.5	7.2	7.7	8.0
3H	6.6	7.1	6.9	7.4	7.6	6.8	7.3	7.1	7.6	7.9
4H	6.5	7.0	6.9	7.3	7.6	6.8	7.2	7.1	7.5	7.8
6H	6.4	6.8	6.8	7.2	7.5	6.7	7.1	7.0	7.4	7.7
8H	6.4	6.8	6.8	7.1	7.5	6.6	7.0	7.0	7.3	7.7
12H	6.3	6.7	6.7	7.0	7.4	6.5	6.9	7.0	7.3	7.7
8H 4H	6.4	6.8	6.8	7.1	7.5	6.6	7.0	7.0	7.3	7.7
6H	6.3	6.6	6.7	7.0	7.4	6.5	6.8	6.9	7.2	7.6
8H	6.2	6.5	6.6	6.9	7.3	6.4	6.7	6.9	7.1	7.6
12H	6.1	6.4	6.6	6.8	7.3	6.4	6.6	6.8	7.1	7.5
12H 4H	6.3	6.7	6.7	7.0	7.4	6.5	6.9	7.0	7.3	7.7
6H	6.2	6.5	6.6	6.9	7.3	6.4	6.7	6.9	7.1	7.6
8H	6.1	6.4	6.6	6.8	7.3	6.4	6.6	6.8	7.1	7.5
Variations with the observer position at spacings:										
S = 1.0H	+ 2.4 / - 7.4					+ 2.4 / - 7.1				
1.5H	+ 3.4 / - 5.3					+ 3.4 / - 5.3				
2.0H	+ 5.2 / - 7.9					+ 5.3 / - 7.9				

CIE Pub.117, 3488 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = 4.3)  
 Area: 0.020096 m2

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2023-08-18

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
 Humidity:58%  
 Test Distance:8.967m [K=1.0000]  
 Remarks:

**UTILIZATION FACTORS TABLE**

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	90	84	81	90	84	81	89	84	81	77
0.80	97	92	89	97	92	88	95	91	88	85
1.00	101	96	93	100	96	92	99	95	92	88
1.25	105	100	97	104	100	97	102	98	96	92
1.50	107	103	100	106	102	99	104	101	98	94
2.00	110	106	103	108	105	102	106	103	101	96
2.50	111	108	105	110	106	104	106	104	102	96
3.00	112	109	107	111	108	106	107	105	104	97
4.00	114	112	110	112	110	108	109	107	106	99
5.00	116	114	112	113	112	110	110	108	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended				SHRNOM = 1.25			

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2023-08-18

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 0.5DEG  
 Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
 Humidity:58%  
 Test Distance:8.967m [K=1.0000]  
 Remarks:

**ISOCANDELA DIAGRAM**

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

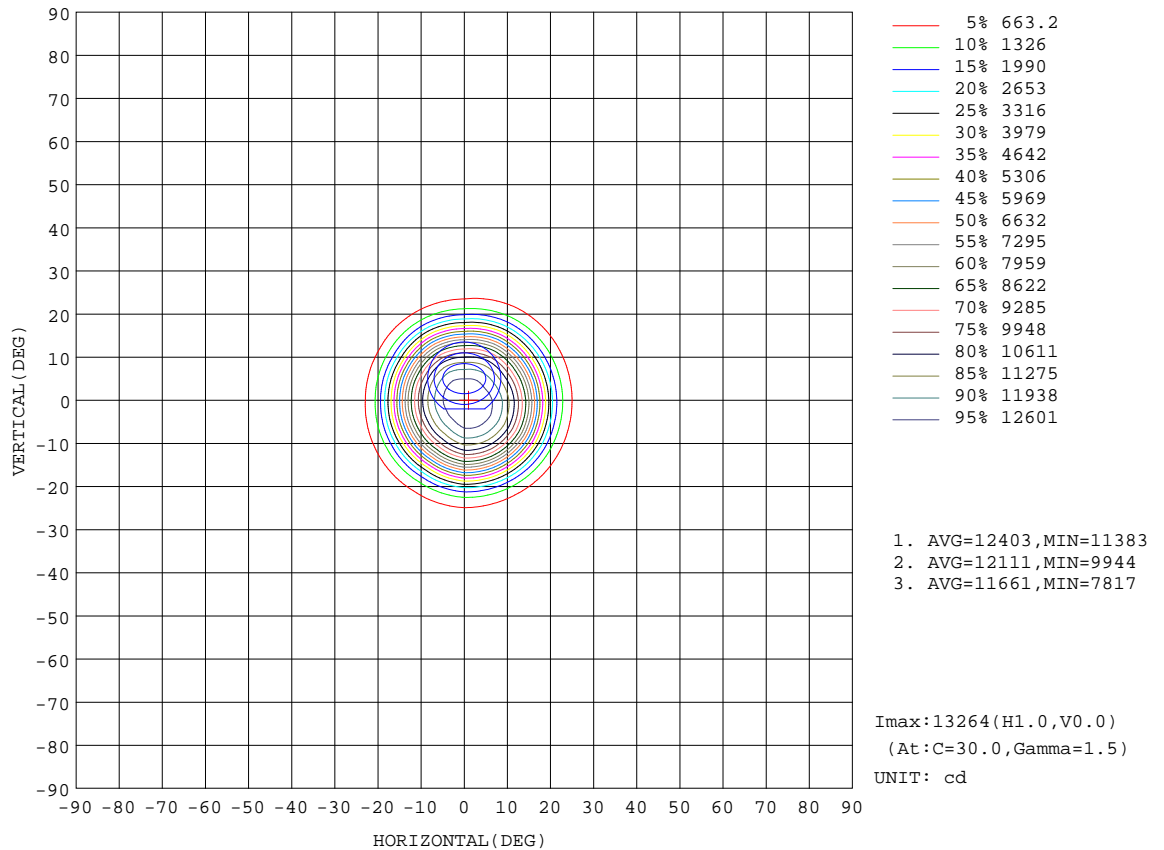

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jasoan  
Test Date:2023-08-18


γ Range: 0 - 90DEG  
γ Interval: 0.5DEG  
Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
Humidity:58%  
Test Distance:8.967m [K=1.0000]  
Remarks:



**AAI Figure**

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

Flux out:2331 lm

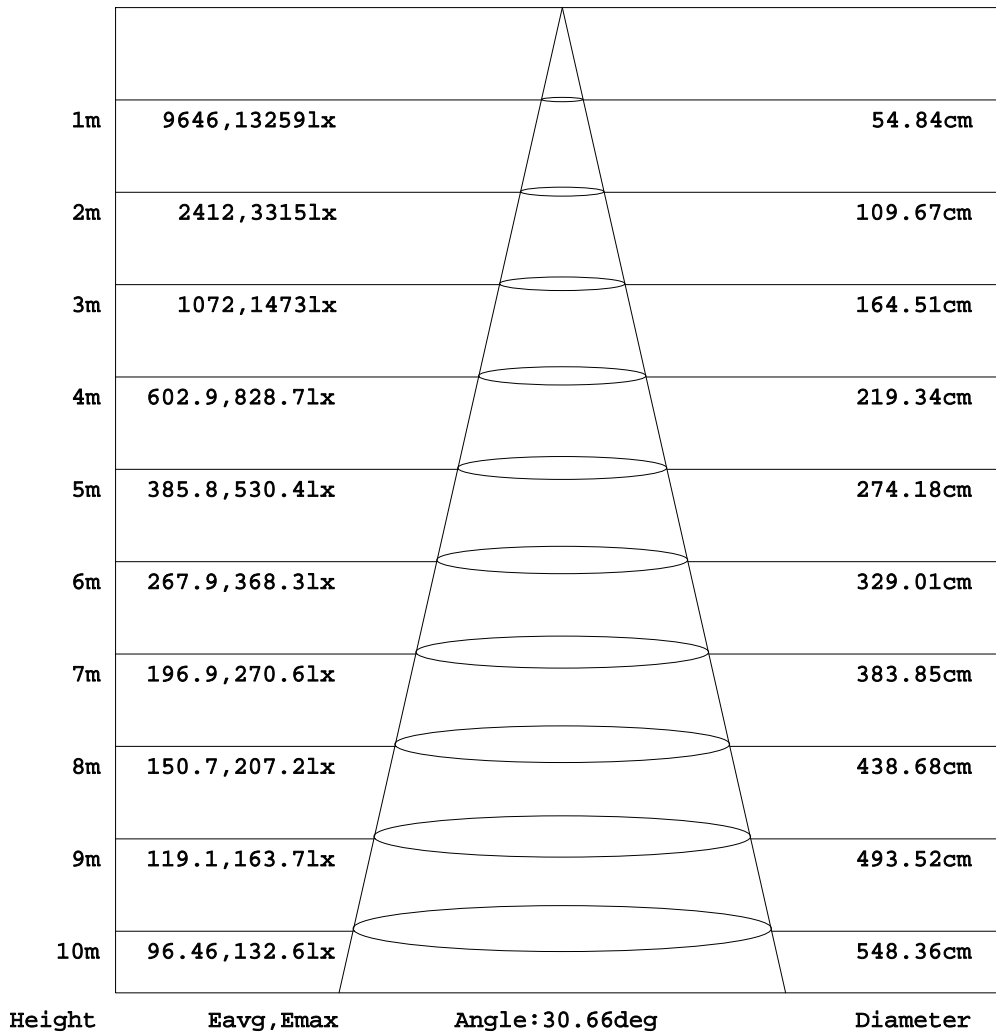


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jasoan  
Test Date:2023-08-18

γ Range: 0 - 90DEG  
γ Interval: 0.5DEG  
Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
Humidity:58%  
Test Distance:8.967m [K=1.0000]  
Remarks:

**ISOLUX DIAGRAM**

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

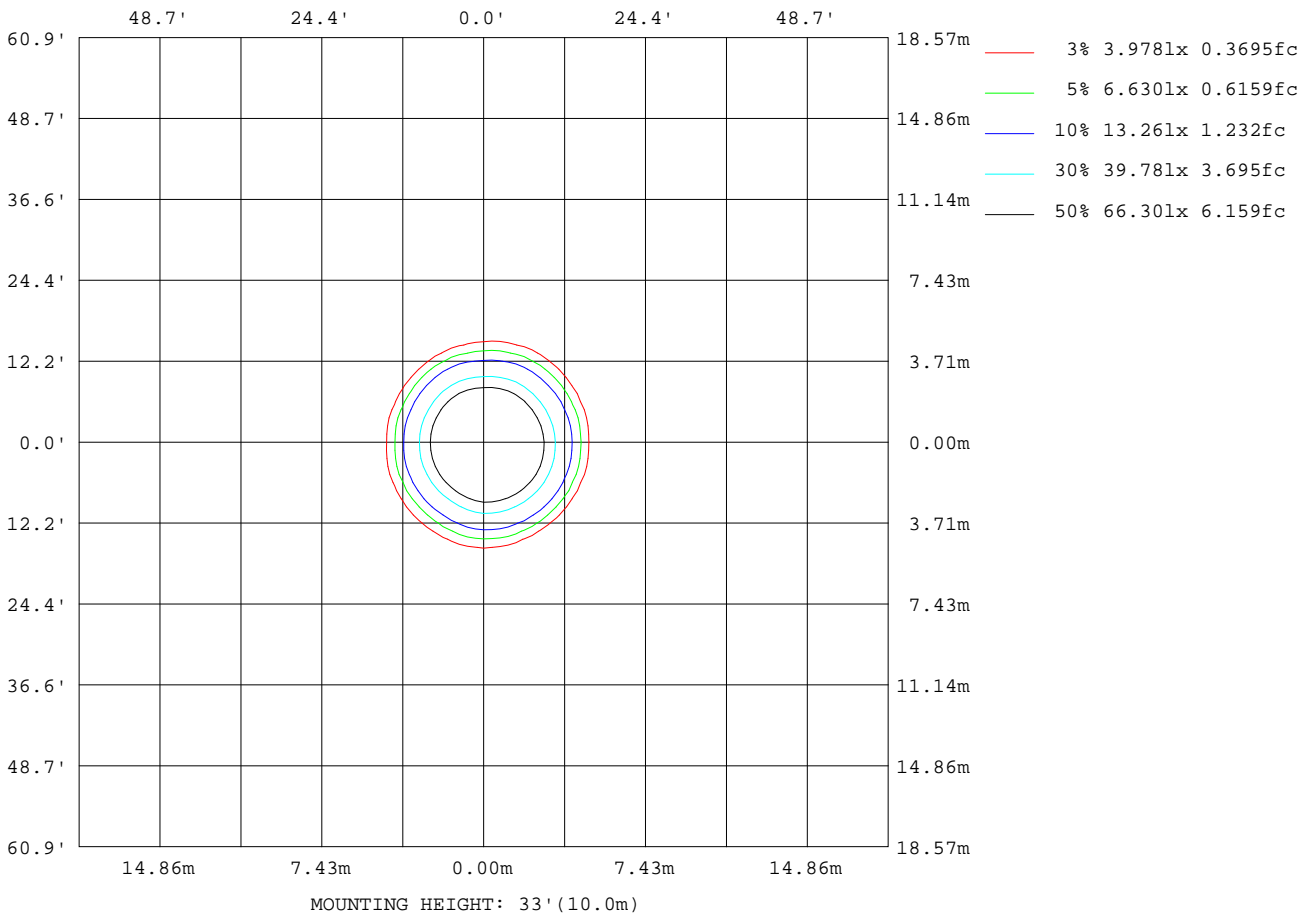

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2023-08-18

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
 Humidity:58%  
 Test Distance:8.967m [K=1.0000]  
 Remarks:

LED Avg.L Report

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		


AvgL	cd/m2
L_0~180 (65) av	510
L_0~180 (75) av	159
L_0~180 (85) av	88
L_90~270 (65) av	545
L_90~270 (75) av	183
L_90~270 (85) av	77
L_45 (65) av	537
L_45 (75) av	176
L_45 (85) av	80

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:Jasoan  
Test Date:2023-08-18

γ Range: 0 - 90DEG  
γ Interval: 0.5DEG  
Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
Humidity:58%  
Test Distance:8.967m [K=1.0000]  
Remarks:

Planar Illuminance Curve

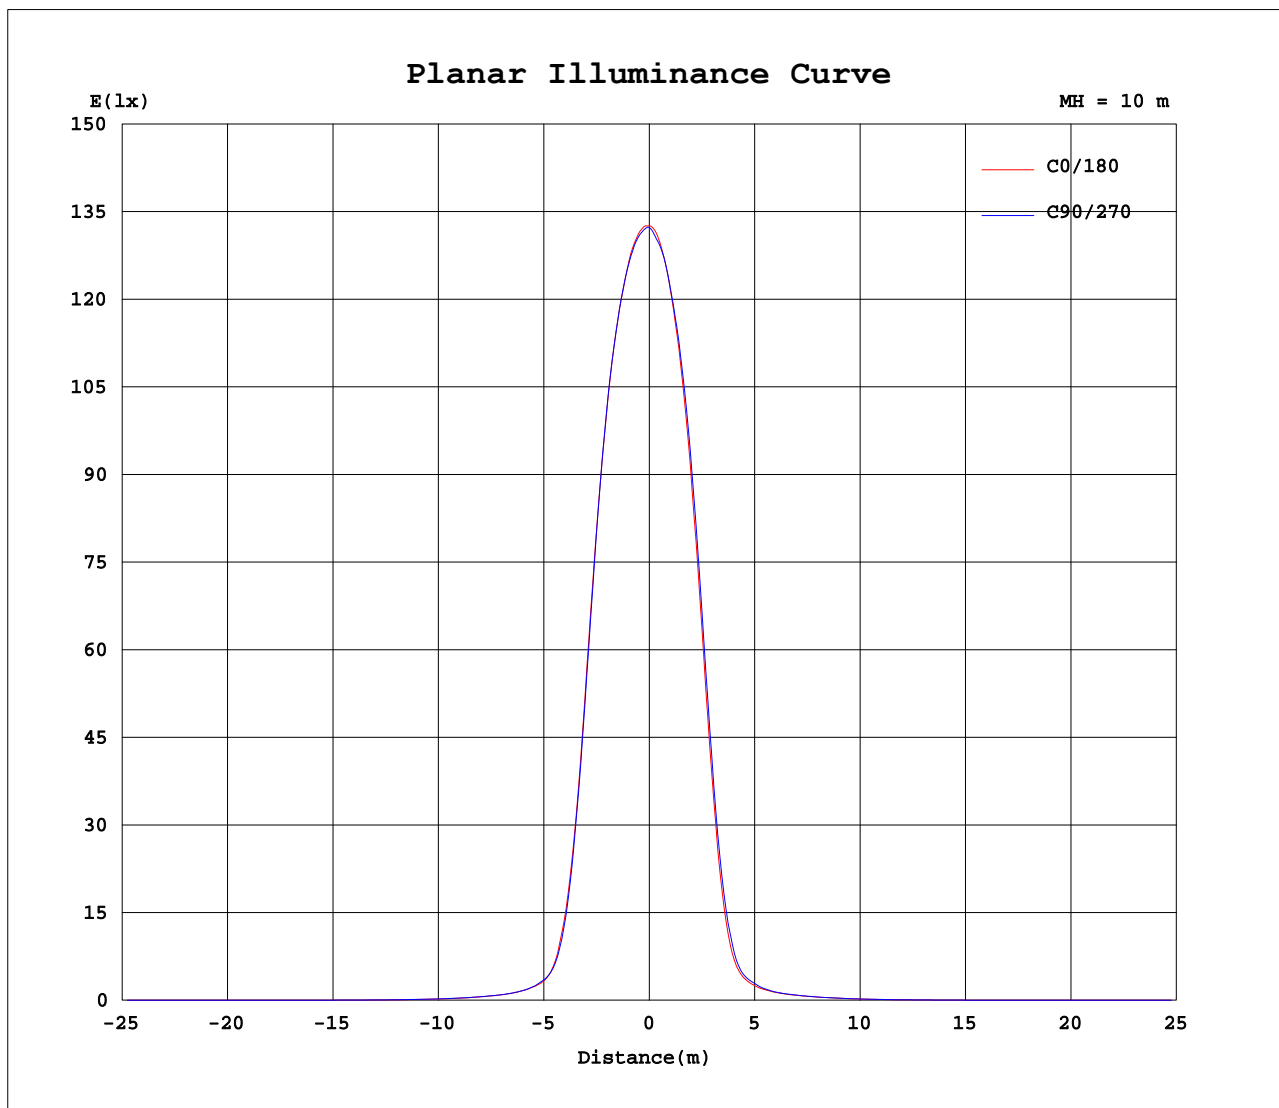

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature: 25.3DEG  
 Operators: Jasoan  
 Test Date: 2023-08-18

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 0.5DEG  
 Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
 Humidity: 58%  
 Test Distance: 8.967m [K=1.0000]  
 Remarks:

**LUMINOUS DISTRIBUTION INTENSITY DATA**

Test:U:220.87V I:0.1245A P:26.889W PF:0.9775 Freq:59.98Hz Lamp Flux:3487.93x1 lm		
NAME: T150 Pro-24W-830-30	TYPE:Downlight	SERIAL No.:
SPEC.:3000K	DIM.: $\phi$ 160mm*H100mm	
MFR.: NEKO LIGHTING AG		

Table--1

UNIT: x10cd

C (DEG) \ $\gamma$ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330										
0	1323	1323	1323	1323	1323	1323	1323	1323	1323	1323	1323	1323										
5	1290	1293	1293	1288	1267	1258	1254	1257	1266	1257	1271	1274										
10	1142	1163	1160	1145	1079	1050	1035	1041	1065	1060	1098	1108										
15	793	824	808	785	676	622	593	591	629	629	706	743										
20	299	315	304	287	213	183	164	161	185	188	239	267										
25	66.1	65.0	62.3	65.0	54.6	48.7	43.9	43.3	45.8	49.8	59.4	63.1										
30	29.4	28.8	28.7	29.7	27.4	25.8	23.8	23.8	24.6	25.3	27.7	28.9										
35	17.3	17.1	17.4	17.8	17.1	16.5	15.4	15.2	15.8	16.0	16.6	17.2										
40	11.0	11.0	11.4	11.7	11.3	10.9	10.5	10.0	10.5	10.7	10.9	11.0										
45	6.57	6.55	6.83	7.13	6.99	6.76	6.52	6.29	6.46	6.54	6.64	6.71										
50	3.50	3.52	3.65	3.91	3.93	3.85	3.77	3.70	3.74	3.72	3.77	3.72										
55	1.73	1.70	1.78	1.96	1.98	1.96	1.94	1.88	1.93	1.91	1.95	1.89										
60	0.66	0.62	0.65	0.76	0.82	0.83	0.84	0.86	0.87	0.84	0.85	0.78										
65	0.38	0.35	0.38	0.44	0.48	0.48	0.48	0.50	0.50	0.49	0.49	0.46										
70	0.20	0.18	0.20	0.23	0.25	0.25	0.25	0.25	0.25	0.25	0.26	0.24										
75	0.08	0.07	0.08	0.09	0.11	0.10	0.08	0.08	0.08	0.10	0.10	0.10										
80	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02										
85	0.02	0.01	0.02	0.01	0.01	0.01	0.02	0.01	0.01	0.01	0.01	0.01										
90	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01										

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2023-08-18

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 0.5DEG  
 Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.362  
 Humidity:58%  
 Test Distance:8.967m [K=1.0000]  
 Remarks: