
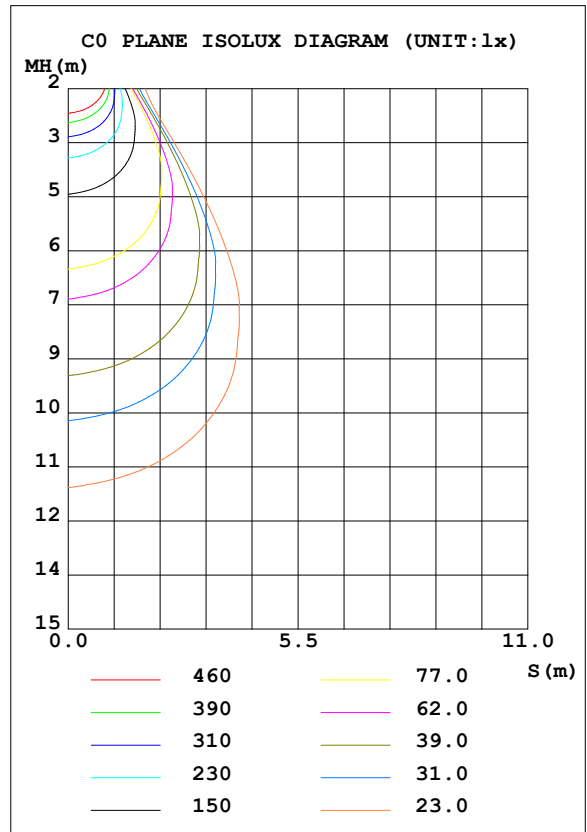


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:220.2V I:0.1245A P:26.89W PF:0.9775 Freq:49.90Hz Lamp Flux:3080.22x1 lm		
NAME: T150 Pro-24W-840-65	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

DATA OF LAMP		PHOTOMETRIC DATA Eff: 114.56 lm/W			
MODEL	CITIZEN-4000K	I _{max} (cd)	3175	S/MH (C0/180)	0.96
NOMINAL POWER (W)	27	LOR (%)	100.0	S/MH (C90/270)	0.92
RATED VOLTAGE (V)	220	TOTAL FLUX (lm)	3080.2	η UP, DN (C0-180)	0.0, 50.7
NOMINAL FLUX (lm)	3080.22	CIE CLASS	DIRECT	η UP, DN (C180-360)	0.0, 49.3
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.75
TEST VOLTAGE (V)	220	η down (%)	100.0	CIBSE SHR MAX	0.95

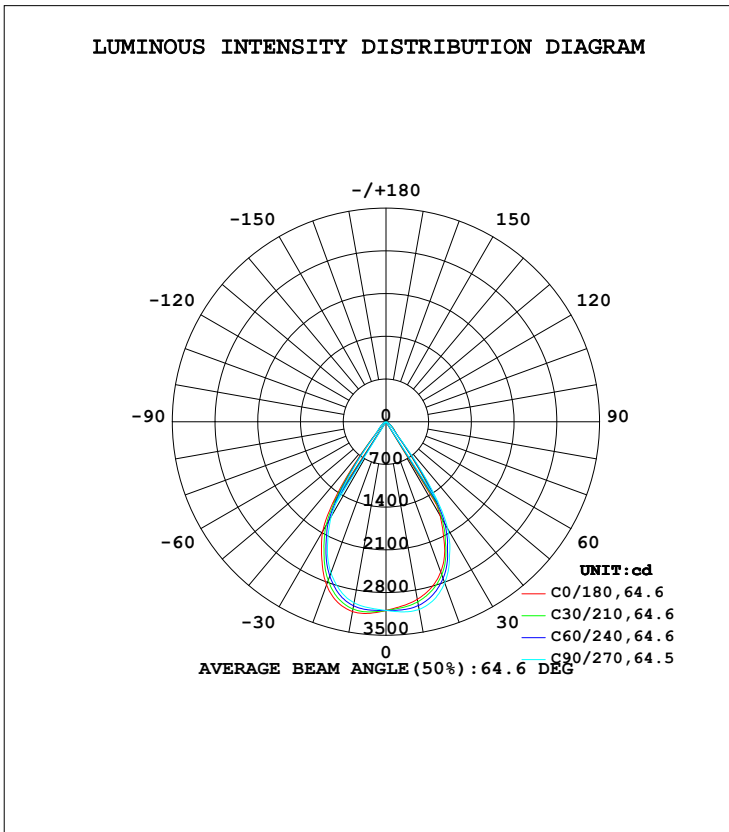

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Jasoan
 Test Date: 2023-07-09

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.362
 Humidity: 58%
 Test Distance: 9.767m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	2954	3027	3122	3164	3158	3089	3013	2967	0- 10	294.4	294.4	9.56,9.56
20	2622	2701	2812	2863	2847	2730	2636	2621	10- 20	825.3	1120	36.4,36.4
30	1781	1889	2028	2082	2075	1922	1796	1794	20- 30	1081	2200	71.4,71.4
40	296.5	294.2	300.7	291.0	293.1	262.2	263.0	298.7	30- 40	648.7	2849	92.5,92.5
50	132.4	121.1	109.8	103.5	99.33	100.8	113.1	134.9	40- 50	135.0	2984	96.9,96.9
60	44.31	39.54	35.69	33.99	31.57	32.03	36.61	45.95	50- 60	64.04	3048	99,99
70	17.30	15.31	13.66	12.81	11.75	12.06	14.18	18.22	60- 70	24.83	3073	99.8,99.8
80	1.302	1.038	0.6415	0.3641	0.3029	0.3555	0.6061	1.341	70- 80	6.965	3080	100,100
90	0.1227	0.1227	0.1228	0.1293	0.1421	0.1356	0.1421	0.1390	80- 90	0.2457	3080	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 2927.3 lm

%lum = 95.0%
%lamp = 95.0%

Conical surface Flux(120deg): 3048.2 lm


%lum = 99.0%
%lamp = 99.0%

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2023-07-09

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:9.767m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:220.2V I:0.1245A P:26.89W PF:0.9775 Freq:49.90Hz Lamp Flux:3080.22x1 lm		
NAME: T150 Pro-24W-840-65	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

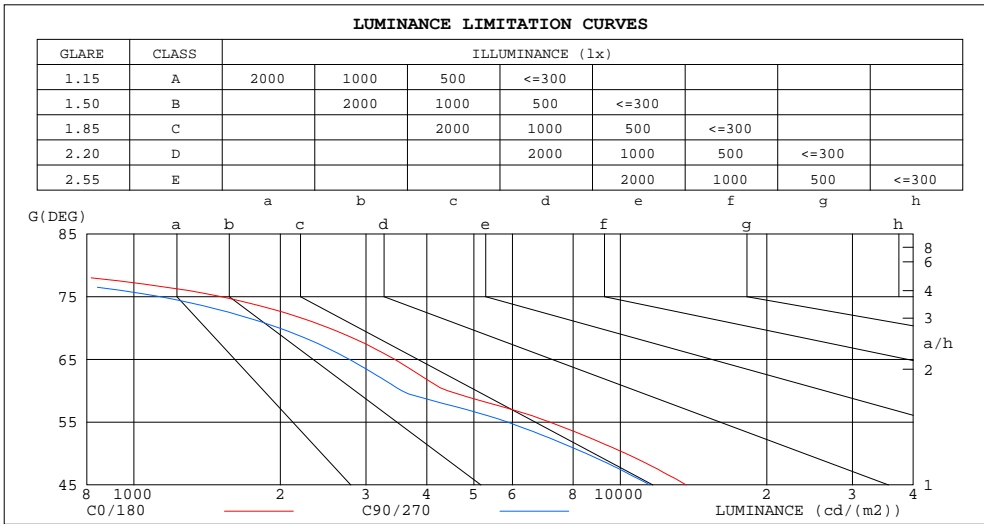

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	129	74
80	373	184
75	1509	1130
70	2517	1988
65	3436	2772
60	4411	3553
55	7155	5861
50	10255	8505
45	13656	11499


C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Jasoan
 Test Date:2023-07-09

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
 Humidity:58%
 Test Distance:9.767m [K=1.0000]
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:220.2V I:0.1245A P:26.89W PF:0.9775 Freq:49.90Hz Lamp Flux:3080.22x1 lm		
NAME: T150 Pro-24W-840-65	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

pcc	80%			70%			50%			30%			10%			0
	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρw																0
ρfc																0
RCR	RCR:Room Cavity Ratio															
	Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.11	1.08	1.06	1.08	1.06	1.04	1.04	1.03	1.01	1.01	.99	.98	.97	.96	.95	.93
2.0	1.03	.99	.95	1.01	.97	.94	.98	.95	.92	.95	.92	.90	.92	.90	.88	.87
3.0	.96	.91	.87	.94	.90	.86	.92	.88	.84	.89	.86	.83	.87	.84	.82	.80
4.0	.89	.84	.79	.88	.83	.79	.86	.81	.78	.84	.80	.77	.82	.79	.76	.75
5.0	.83	.78	.73	.82	.77	.73	.81	.76	.72	.79	.75	.72	.77	.74	.71	.69
6.0	.78	.72	.68	.77	.72	.68	.76	.71	.67	.74	.70	.67	.73	.69	.66	.65
7.0	.73	.67	.63	.73	.67	.63	.71	.66	.63	.70	.66	.62	.69	.65	.62	.60
8.0	.69	.63	.59	.69	.63	.59	.67	.62	.59	.66	.62	.58	.65	.61	.58	.57
9.0	.65	.59	.55	.65	.59	.55	.64	.59	.55	.63	.58	.55	.62	.58	.55	.53
10.0	.62	.56	.52	.61	.56	.52	.60	.55	.52	.60	.55	.51	.59	.54	.51	.50

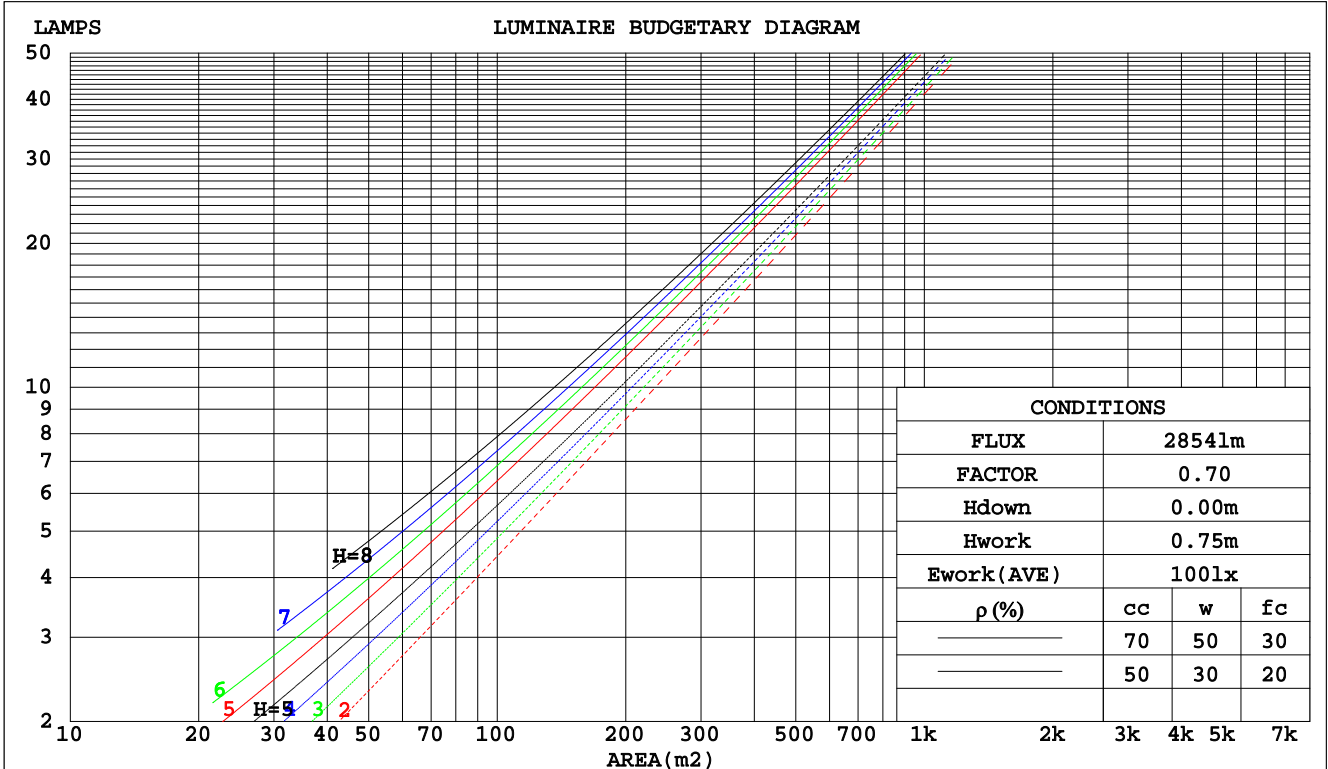

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Jasoan
 Test Date:2023-07-09

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
 Humidity:58%
 Test Distance:9.767m [K=1.0000]
 Remarks:

WEC AND CCEC

Test:U:220.2V I:0.1245A P:26.89W PF:0.9775 Freq:49.90Hz Lamp Flux:3080.22x1 lm		
NAME: T150 Pro-24W-840-65	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.181	.103	.033	.174	.099	.032	.162	.093	.030	.150	.086	.028	.139	.081	.026	
2.0	.174	.095	.029	.168	.093	.029	.157	.088	.027	.148	.083	.026	.139	.078	.025	
3.0	.166	.088	.026	.161	.086	.026	.152	.082	.025	.143	.079	.024	.136	.075	.023	
4.0	.158	.082	.024	.154	.080	.024	.146	.077	.023	.139	.074	.022	.132	.072	.022	
5.0	.150	.077	.022	.147	.075	.022	.140	.073	.021	.134	.070	.021	.128	.068	.020	
6.0	.144	.072	.021	.140	.071	.020	.134	.069	.020	.129	.067	.020	.123	.065	.019	
7.0	.137	.068	.019	.134	.067	.019	.129	.065	.019	.124	.064	.019	.119	.062	.018	
8.0	.131	.064	.018	.129	.063	.018	.124	.062	.018	.120	.061	.017	.115	.059	.017	
9.0	.126	.061	.017	.124	.060	.017	.119	.059	.017	.115	.058	.017	.111	.057	.016	
10.0	.121	.058	.016	.119	.057	.016	.115	.056	.016	.111	.055	.016	.108	.054	.016	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.171	.157	.145	.147	.135	.124	.100	.093	.086	.058	.054	.050	.018	.017	.016	
2.0	.156	.132	.112	.134	.114	.097	.092	.079	.068	.053	.046	.040	.017	.015	.013	
3.0	.144	.114	.089	.124	.098	.077	.085	.068	.054	.049	.040	.032	.016	.013	.010	
4.0	.134	.099	.072	.115	.086	.062	.079	.060	.044	.046	.035	.026	.015	.011	.009	
5.0	.126	.087	.059	.108	.076	.051	.074	.053	.036	.043	.031	.022	.014	.010	.007	
6.0	.119	.078	.049	.102	.068	.043	.070	.047	.030	.041	.028	.018	.013	.009	.006	
7.0	.112	.071	.042	.096	.061	.036	.067	.043	.026	.039	.025	.015	.013	.008	.005	
8.0	.107	.065	.036	.092	.056	.031	.063	.039	.022	.037	.023	.013	.012	.008	.004	
9.0	.102	.059	.031	.087	.052	.027	.061	.036	.019	.035	.021	.011	.011	.007	.004	
10.0	.097	.055	.027	.084	.048	.024	.058	.034	.017	.034	.020	.010	.011	.007	.003	

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Jasoan
 Test Date:2023-07-09

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
 Humidity:58%
 Test Distance:9.767m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

Test:U:220.2V I:0.1245A P:26.89W PF:0.9775 Freq:49.90Hz Lamp Flux:3080.22x1 lm		
NAME: T150 Pro-24W-840-65	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	14.2	15.1	14.4	15.3	15.5	14.6	15.6	14.8	15.7	15.9
3H	14.1	15.0	14.3	15.2	15.4	14.5	15.4	14.7	15.6	15.8
4H	14.0	14.9	14.3	15.1	15.3	14.4	15.2	14.7	15.5	15.7
6H	13.9	14.7	14.2	15.0	15.2	14.3	15.1	14.6	15.3	15.6
8H	13.9	14.6	14.2	14.9	15.2	14.3	15.0	14.6	15.3	15.5
12H	13.8	14.6	14.2	14.8	15.1	14.2	14.9	14.5	15.2	15.5
4H 2H	14.0	14.8	14.2	15.0	15.3	14.4	15.2	14.7	15.4	15.7
3H	13.9	14.6	14.2	14.9	15.2	14.3	15.0	14.6	15.3	15.6
4H	13.9	14.5	14.2	14.8	15.1	14.2	14.9	14.6	15.2	15.5
6H	13.8	14.3	14.1	14.7	15.0	14.1	14.7	14.5	15.0	15.4
8H	13.7	14.3	14.1	14.6	15.0	14.1	14.6	14.5	15.0	15.3
12H	13.7	14.2	14.1	14.5	14.9	14.0	14.5	14.4	14.9	15.3
8H 4H	13.7	14.3	14.1	14.6	15.0	14.1	14.6	14.5	15.0	15.3
6H	13.6	14.1	14.1	14.5	14.9	14.0	14.4	14.4	14.8	15.2
8H	13.6	14.0	14.0	14.4	14.8	13.9	14.3	14.4	14.7	15.2
12H	13.5	13.9	14.0	14.3	14.8	13.9	14.2	14.3	14.7	15.1
12H 4H	13.7	14.2	14.1	14.5	14.9	14.0	14.5	14.4	14.9	15.3
6H	13.6	14.0	14.0	14.4	14.8	13.9	14.3	14.4	14.7	15.2
8H	13.5	13.9	14.0	14.3	14.8	13.9	14.2	14.3	14.7	15.1
Variations with the observer position at spacings:										
S = 1.0H	+ 3.1 / - 4.0					+ 4.1 / - 5.6				
1.5H	+ 4.5 / - 2.9					+ 5.9 / - 3.8				
2.0H	+ 3.3 / - 3.6					+ 3.1 / - 3.4				

CIE Pub.117, 3080 lm Total Lamp Luminous Flux Correct (8log(F/F0) = 3.9)

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Jasoan
 Test Date:2023-07-09

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
 Humidity:58%
 Test Distance:9.767m [K=1.0000]
 Remarks:

UTILIZATION FACTORS TABLE

Test:U:220.2V I:0.1245A P:26.89W PF:0.9775 Freq:49.90Hz Lamp Flux:3080.22x1 lm		
NAME: T150 Pro-24W-840-65	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	87	80	76	86	80	76	85	80	76	73
0.80	94	88	85	94	88	84	92	87	84	80
1.00	99	93	90	98	93	89	96	93	89	85
1.25	103	98	94	102	97	94	100	96	93	89
1.50	106	101	98	104	100	97	102	99	96	91
2.00	108	104	101	107	103	100	104	101	99	94
2.50	110	106	103	109	105	102	105	103	100	95
3.00	112	108	106	110	107	104	107	104	102	96
4.00	114	111	109	112	109	107	108	106	105	98
5.00	115	113	111	113	111	109	109	107	106	99
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended				SHRNOM = 1.25			

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Jasoan
 Test Date:2023-07-09

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
 Humidity:58%
 Test Distance:9.767m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:220.2V I:0.1245A P:26.89W PF:0.9775 Freq:49.90Hz Lamp Flux:3080.22x1 lm		
NAME: T150 Pro-24W-840-65	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

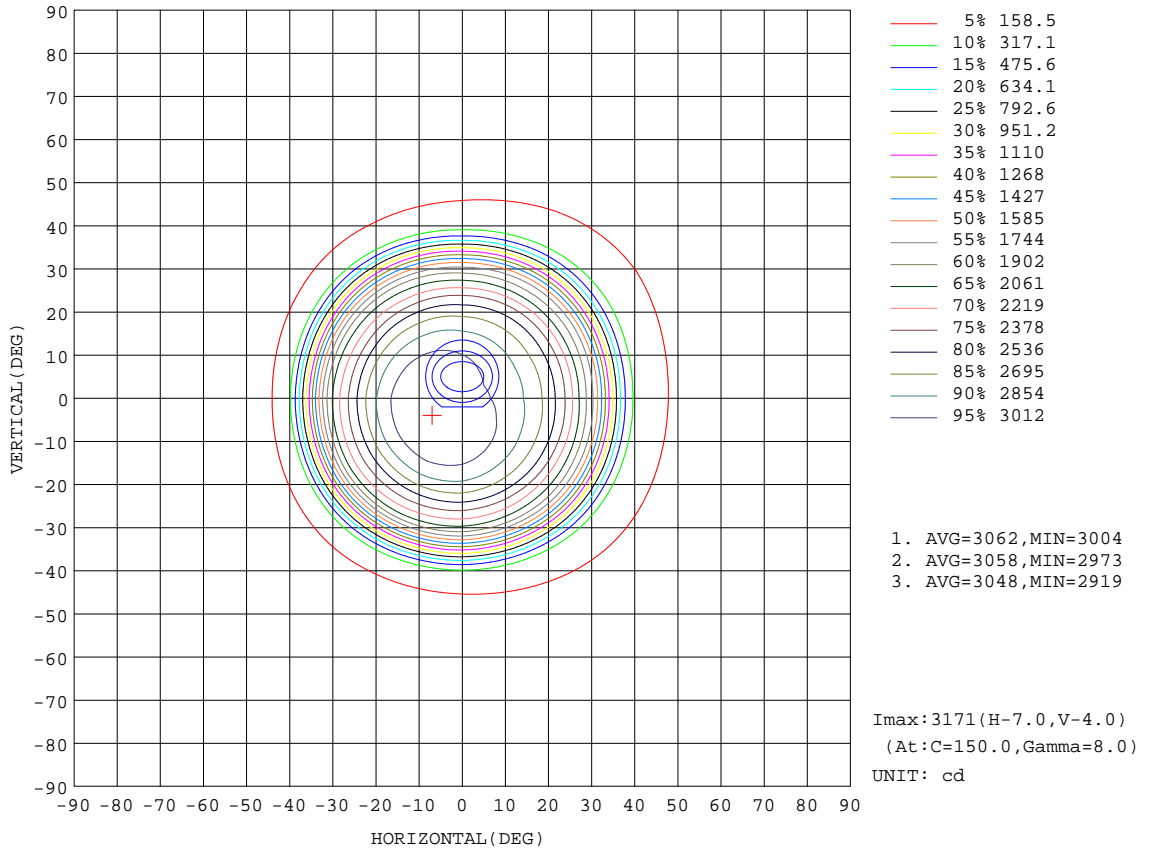


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2023-07-09

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:9.767m [K=1.0000]
Remarks:

AAI Figure

Test:U:220.2V I:0.1245A P:26.89W PF:0.9775 Freq:49.90Hz Lamp Flux:3080.22x1 lm		
NAME: T150 Pro-24W-840-65	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

Flux out:2448 lm

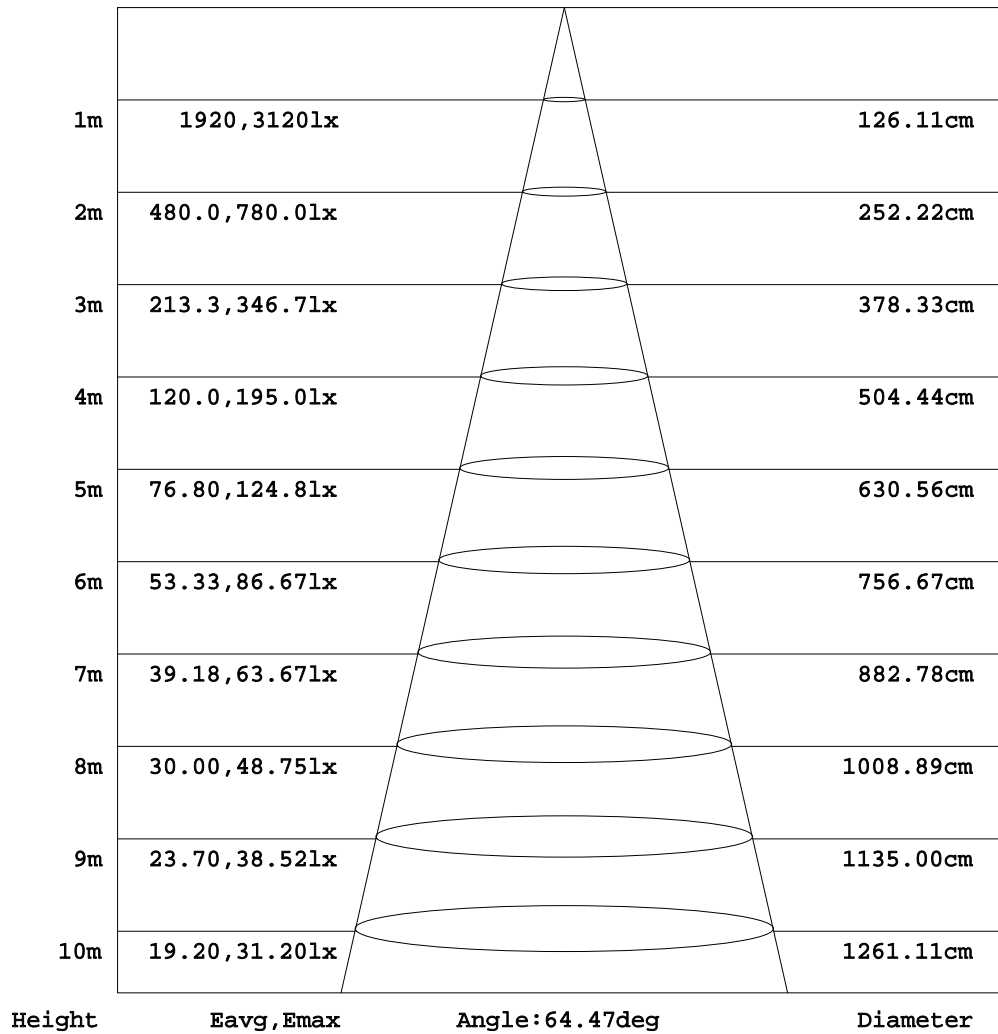


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2023-07-09

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:9.767m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:220.2V I:0.1245A P:26.89W PF:0.9775 Freq:49.90Hz Lamp Flux:3080.22x1 lm		
NAME: T150 Pro-24W-840-65	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		

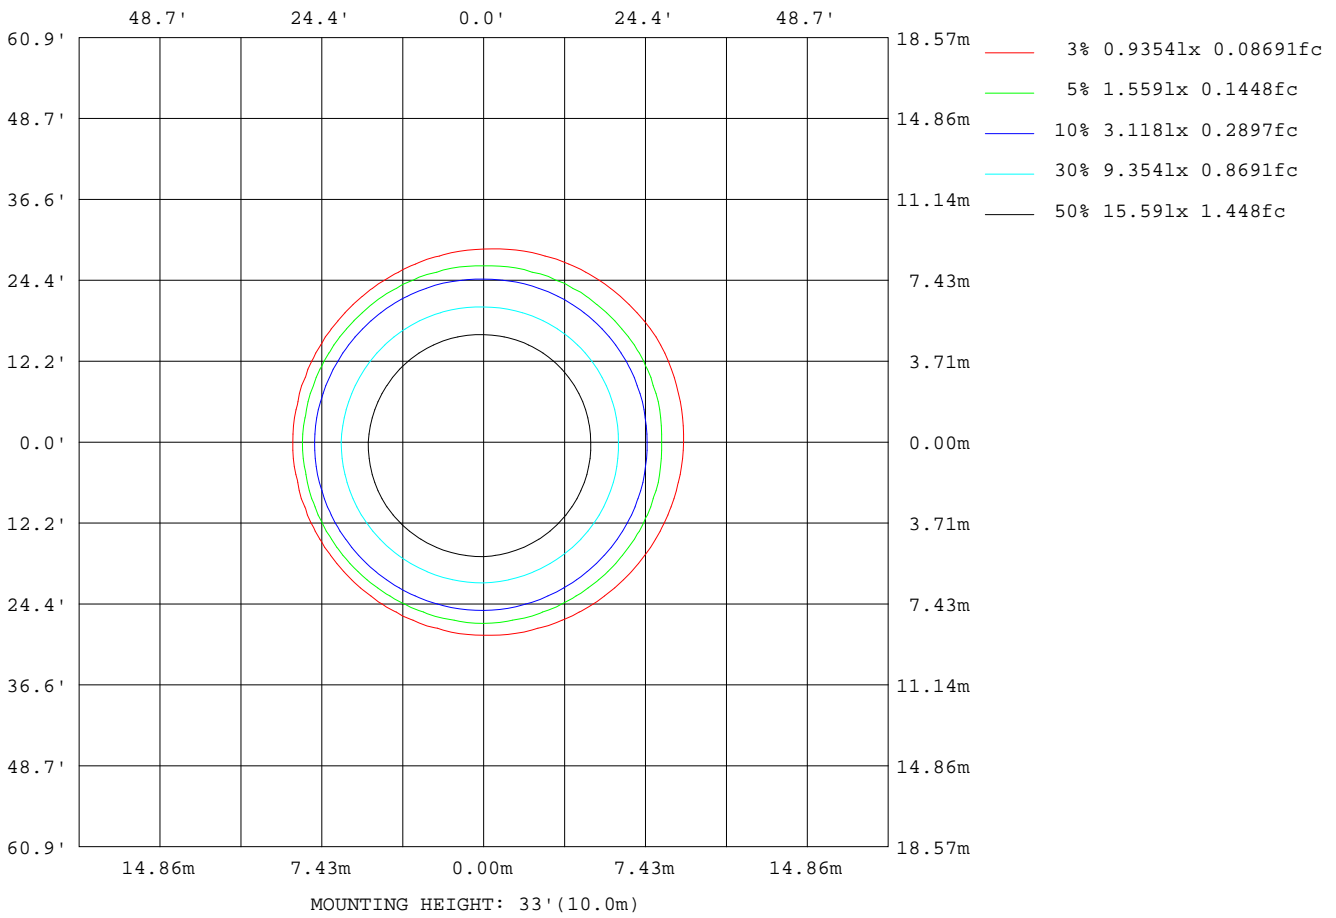

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Jasoan
 Test Date:2023-07-09

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
 Humidity:58%
 Test Distance:9.767m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:220.2V I:0.1245A P:26.89W PF:0.9775 Freq:49.90Hz Lamp Flux:3080.22x1 lm		
NAME: T150 Pro-24W-840-65	TYPE:Downlight	SERIAL No.:
SPEC.:4000K	DIM.: φ160mm*H100mm	
MFR.: NEKO LIGHTING AG		


AvgL	cd/m2
L_0~180 (65) av	2937
L_0~180 (75) av	1200
L_0~180 (85) av	105
L_90~270 (65) av	2816
L_90~270 (75) av	1134
L_90~270 (85) av	94
L_45 (65) av	2953
L_45 (75) av	1202
L_45 (85) av	95

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2023-07-09

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:9.767m [K=1.0000]
Remarks:

Planar Illuminance Curve

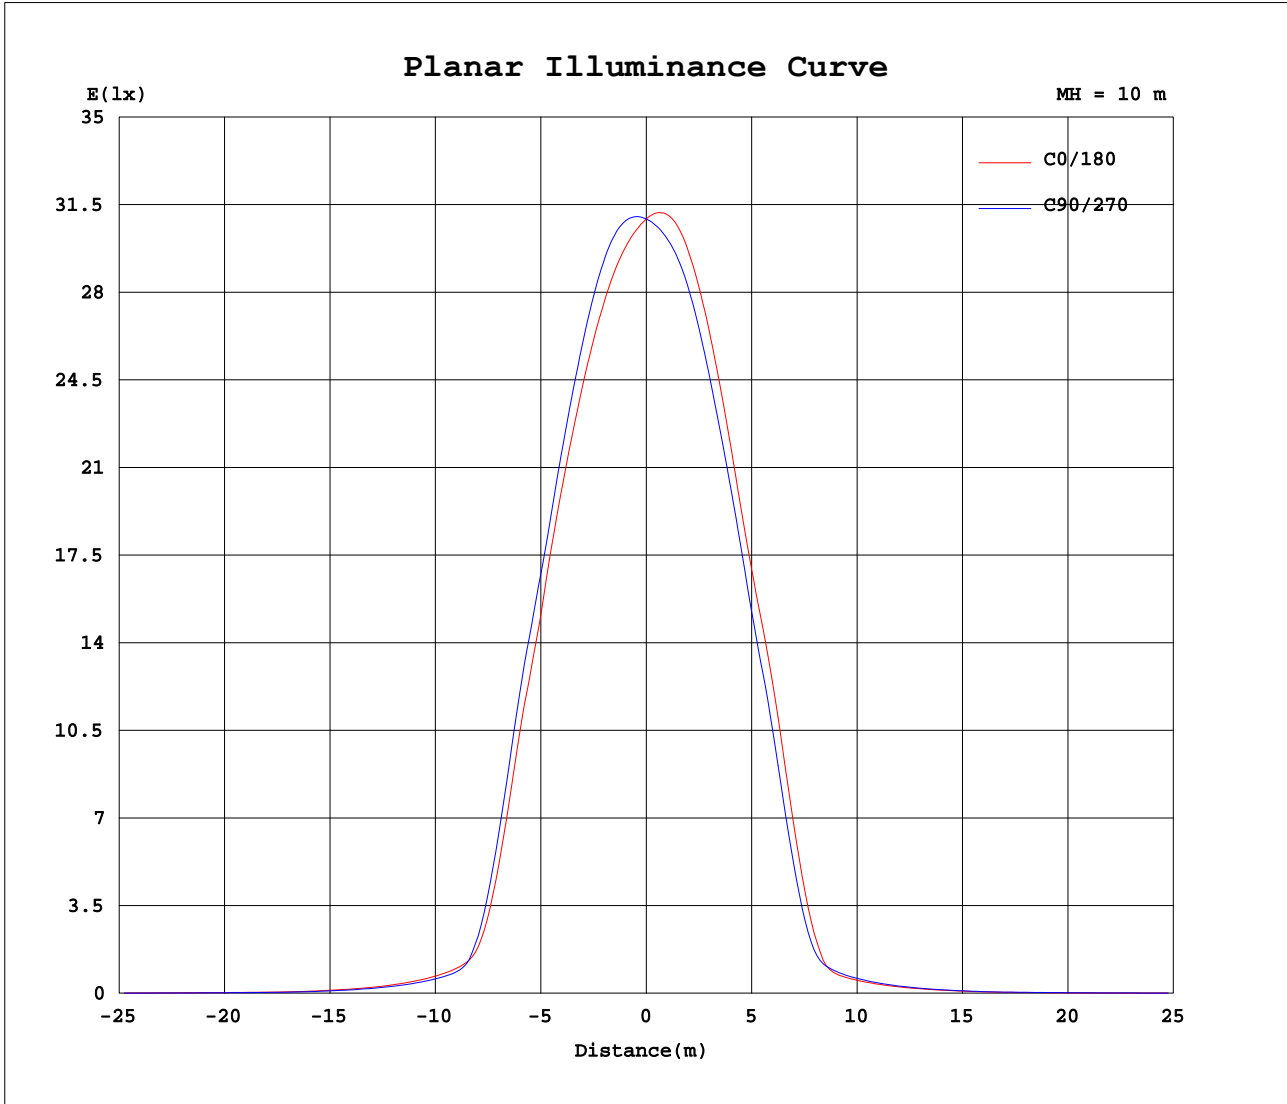

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: Jasoan
 Test Date: 2023-07-09

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.362
 Humidity: 58%
 Test Distance: 9.767m [K=1.0000]
 Remarks:

