


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:221.0V I:0.1071A P:13.70W PF:0.5786 Freq:49.99Hz Lamp Flux:1181.27x1 lm		
NAME: VIBES-VISC-14W-927-36°	TYPE:Downlight	SERIAL No.:
SPEC.:2700K	DIM.: $\varnothing 77\text{mm} \times \text{H}39\text{mm} \times 2$	
MFR.: NEKO LIGHTING AG		

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 86.25 lm/W
MODEL	2700K	I _{max} (cd)	2165	S/MH (C0/180)	0.55	
NOMINAL POWER (W)	14	LOR (%)	100.0	S/MH (C90/270)	0.54	
RATED VOLTAGE (V)	220	TOTAL FLUX (lm)	1181.3	η UP, DN (C0-180)	0.0, 52.5	
NOMINAL FLUX (lm)	1181.27	CIE CLASS	DIRECT	η UP, DN (C180-360)	0.0, 47.5	
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.50	
TEST VOLTAGE (V)	220	η down (%)	100.0	CIBSE SHR MAX	0.60	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

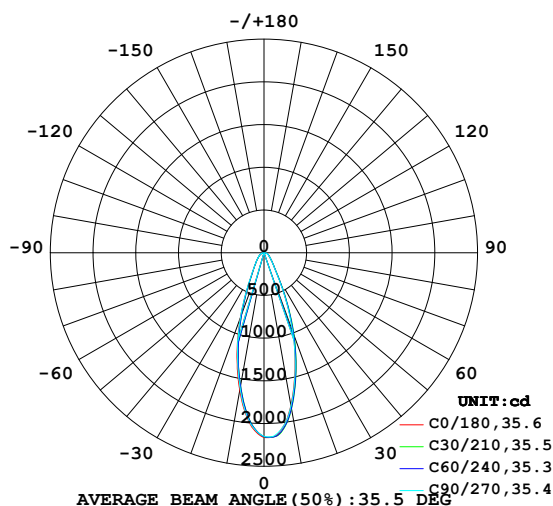

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

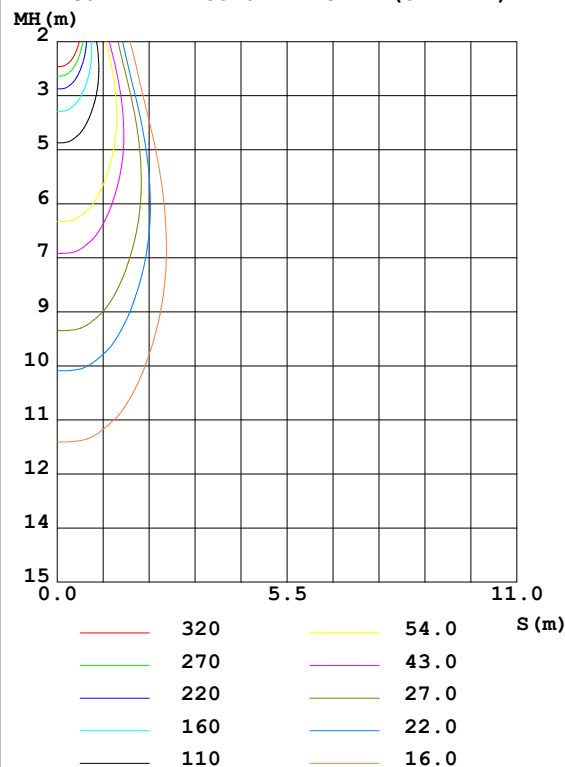

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Jasoan
Test Date: 2022-11-28

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity: 58%
Test Distance: 8.967m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1815	1853	1822	1704	1635	1582	1612	1724	0- 10	184.3	184.3	15.6,15.6
20	994.1	1024	981.2	868.7	808.5	768.3	807.2	908.9	10- 20	357.6	542.0	45.9,45.9
30	345.5	354.4	339.8	302.2	281.5	273.0	285.8	318.3	20- 30	251.4	793.4	67.2,67.2
40	158.7	158.0	156.4	151.0	146.4	145.7	147.7	155.9	30- 40	133.2	926.6	78.4,78.4
50	96.53	95.14	95.42	93.17	91.04	90.59	93.45	97.15	40- 50	91.98	1019	86.2,86.2
60	67.44	66.50	66.07	62.75	59.92	59.57	62.64	66.75	50- 60	69.49	1088	92.1,92.1
70	45.65	45.80	44.28	40.01	36.87	36.15	38.82	43.36	60- 70	51.88	1140	96.5,96.5
80	23.93	24.94	22.75	15.89	12.61	11.78	13.74	19.29	70- 80	32.00	1172	99.2,99.2
90	4.074	4.488	2.881	0.1988	0.2614	0.2832	0.2560	1.422	80- 90	9.281	1181	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 976.16 lm

%lum = 82.6%

%lamp = 82.6%

Conical surface Flux(120deg): 1088.1 lm

%lum = 92.1%


%lamp = 92.1%

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2022-11-28

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:8.967m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:221.0V I:0.1071A P:13.70W PF:0.5786 Freq:49.99Hz Lamp Flux:1181.27x1 lm		
NAME: VIBES-VISC-14W-927-36°	TYPE:Downlight	SERIAL No.:
SPEC.:2700K	DIM.: $\phi 77\text{mm} \times H39\text{mm} \times 2$	
MFR.: NEKO LIGHTING AG		

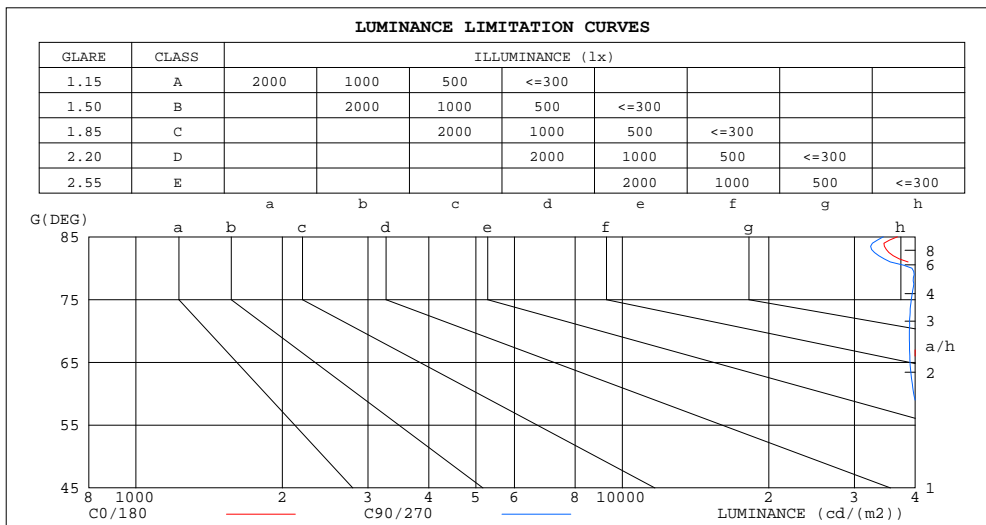

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	36760	34381
80	41429	39389
75	40735	39271
70	40119	38920
65	40017	39019
60	40548	39719
55	41856	41297
50	45144	44622
45	51405	50829


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2022-11-28

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:8.967m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:221.0V I:0.1071A P:13.70W PF:0.5786 Freq:49.99Hz Lamp Flux:1181.27x1 lm		
NAME: VIBES-VISC-14W-927-36°	TYPE:Downlight	SERIAL No.:
SPEC.:2700K	DIM.: φ77mm*H39mm*2	
MFR.: NEKO LIGHTING AG		

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.09	1.06	1.04	1.07	1.04	1.02	1.03	1.01	.99	.99	.97	.96	.96	.94	.93	.91
2.0	1.00	.96	.92	.99	.94	.91	.95	.92	.89	.92	.89	.87	.89	.87	.85	.83
3.0	.93	.87	.83	.91	.86	.82	.89	.84	.81	.86	.83	.79	.84	.81	.78	.77
4.0	.86	.80	.76	.85	.80	.75	.83	.78	.74	.81	.77	.73	.79	.76	.73	.71
5.0	.81	.75	.70	.80	.74	.70	.78	.73	.69	.76	.72	.68	.75	.71	.68	.66
6.0	.76	.70	.65	.75	.69	.65	.74	.68	.65	.72	.68	.64	.71	.67	.64	.62
7.0	.72	.66	.61	.71	.65	.61	.70	.65	.61	.69	.64	.60	.68	.63	.60	.59
8.0	.68	.62	.58	.68	.62	.58	.66	.61	.57	.65	.61	.57	.64	.60	.57	.55
9.0	.65	.59	.55	.64	.58	.55	.63	.58	.54	.62	.58	.54	.62	.57	.54	.53
10.0	.62	.56	.52	.61	.56	.52	.60	.55	.52	.60	.55	.52	.59	.55	.51	.50

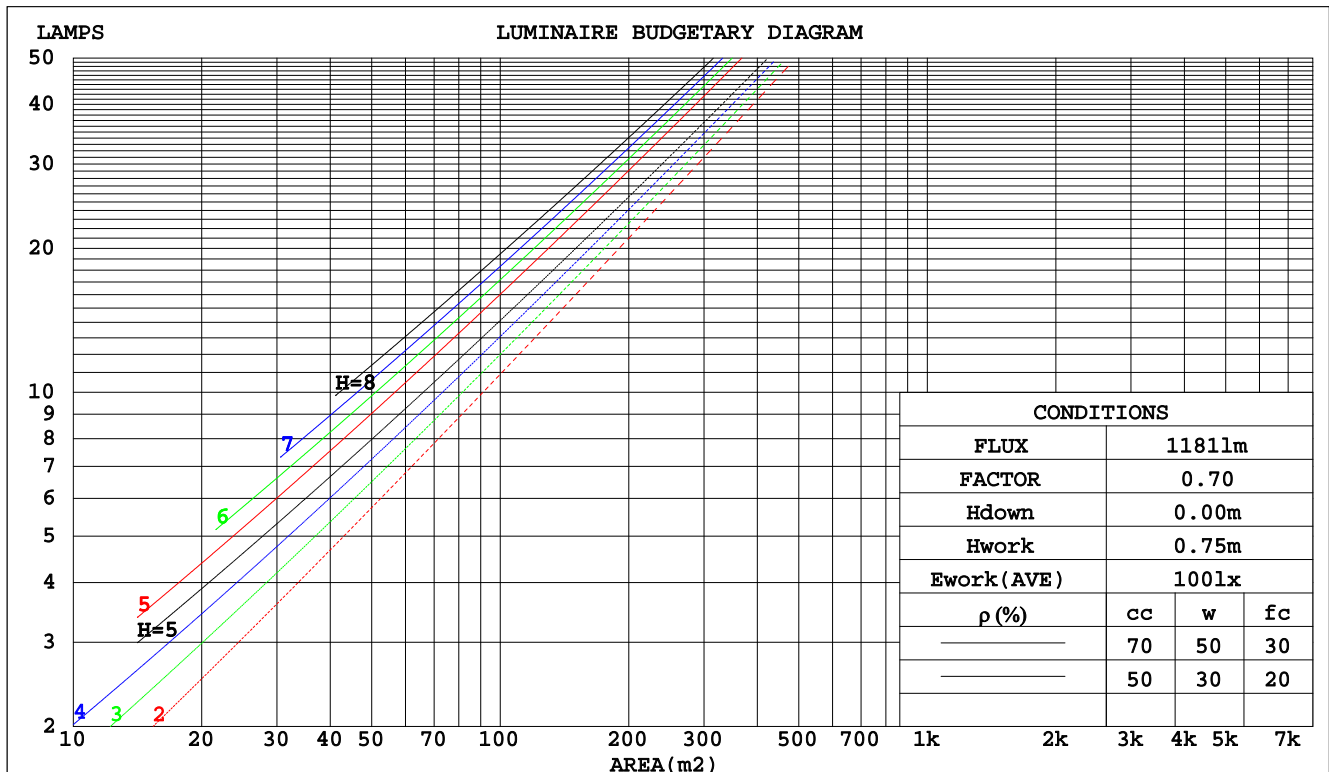

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2022-11-28

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:8.967m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:221.0V I:0.1071A P:13.70W PF:0.5786 Freq:49.99Hz Lamp Flux:1181.27x1 lm		
NAME: VIBES-VISC-14W-927-36°	TYPE:Downlight	SERIAL No.:
SPEC.:2700K	DIM.: φ77mm*H39mm*2	
MFR.: NEKO LIGHTING AG		

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.210	.119	.038	.203	.116	.037	.190	.109	.035	.179	.103	.033	.168	.097	.031	
2.0	.197	.108	.033	.191	.105	.032	.180	.100	.031	.170	.096	.030	.161	.091	.029	
3.0	.184	.098	.029	.179	.096	.029	.169	.092	.028	.161	.088	.027	.153	.085	.026	
4.0	.171	.089	.026	.167	.087	.026	.159	.084	.025	.151	.081	.025	.144	.078	.024	
5.0	.160	.082	.024	.156	.080	.023	.149	.078	.023	.143	.075	.022	.137	.073	.022	
6.0	.150	.075	.022	.147	.074	.021	.141	.072	.021	.135	.070	.021	.130	.068	.020	
7.0	.142	.070	.020	.139	.069	.020	.133	.067	.019	.128	.066	.019	.123	.064	.019	
8.0	.134	.065	.018	.131	.065	.018	.126	.063	.018	.122	.062	.018	.118	.060	.018	
9.0	.127	.061	.017	.125	.061	.017	.120	.059	.017	.116	.058	.017	.112	.057	.016	
10.0	.121	.058	.016	.119	.057	.016	.115	.056	.016	.111	.055	.016	.108	.054	.016	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.173	.157	.142	.148	.135	.122	.101	.093	.085	.058	.054	.049	.019	.017	.016	
2.0	.160	.132	.109	.137	.114	.095	.094	.079	.066	.054	.046	.039	.017	.015	.013	
3.0	.148	.114	.087	.127	.098	.075	.087	.068	.053	.050	.040	.031	.016	.013	.010	
4.0	.138	.099	.070	.118	.086	.061	.081	.060	.043	.047	.035	.025	.015	.011	.008	
5.0	.129	.088	.058	.111	.076	.050	.076	.053	.035	.044	.031	.021	.014	.010	.007	
6.0	.121	.079	.048	.104	.068	.042	.072	.048	.030	.042	.028	.018	.013	.009	.006	
7.0	.114	.071	.041	.098	.062	.036	.068	.043	.025	.039	.025	.015	.013	.008	.005	
8.0	.108	.065	.035	.093	.056	.031	.064	.039	.022	.037	.023	.013	.012	.008	.004	
9.0	.102	.059	.031	.088	.052	.027	.061	.036	.019	.035	.021	.011	.011	.007	.004	
10.0	.097	.055	.027	.084	.048	.024	.058	.034	.017	.034	.020	.010	.011	.007	.003	

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2022-11-28

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:8.967m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:221.0V I:0.1071A P:13.70W PF:0.5786 Freq:49.99Hz Lamp Flux:1181.27x1 lm										
NAME: VIBES-VISC-14W-927-36°					TYPE:Downlight			SERIAL No.:		
SPEC.:2700K					DIM.: $\phi 77\text{mm} \times \text{H}39\text{mm} \times 2$					
MFR.: NEKO LIGHTING AG										
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	22.5	23.5	22.7	23.7	23.9	22.4	23.4	22.6	23.6	23.8
3H	24.0	25.0	24.3	25.2	25.4	23.9	24.8	24.2	25.0	25.2
4H	24.7	25.6	25.0	25.9	26.1	24.6	25.5	24.9	25.7	26.0
6H	25.4	26.2	25.7	26.5	26.7	25.2	26.1	25.5	26.3	26.6
8H	25.6	26.4	25.9	26.7	26.9	25.4	26.2	25.7	26.5	26.7
12H	25.7	26.5	26.0	26.8	27.1	25.5	26.3	25.8	26.6	26.9
4H 2H	23.1	24.0	23.3	24.2	24.4	23.0	23.9	23.3	24.1	24.4
3H	24.8	25.6	25.1	25.9	26.2	24.7	25.5	25.0	25.8	26.1
4H	25.7	26.4	26.1	26.7	27.1	25.6	26.3	25.9	26.6	26.9
6H	26.5	27.2	26.9	27.5	27.9	26.4	27.0	26.7	27.3	27.7
8H	26.8	27.4	27.2	27.7	28.1	26.6	27.2	27.0	27.5	27.9
12H	26.9	27.5	27.4	27.9	28.3	26.7	27.3	27.2	27.7	28.1
8H 4H	26.1	26.7	26.5	27.0	27.4	25.9	26.5	26.3	26.9	27.3
6H	27.1	27.6	27.5	28.0	28.4	26.9	27.4	27.3	27.8	28.2
8H	27.4	27.8	27.9	28.3	28.7	27.2	27.7	27.7	28.1	28.5
12H	27.7	28.0	28.1	28.5	29.0	27.5	27.8	27.9	28.3	28.8
12H 4H	26.1	26.6	26.5	27.0	27.4	26.0	26.5	26.4	26.9	27.3
6H	27.1	27.6	27.6	28.0	28.4	27.0	27.4	27.4	27.9	28.3
8H	27.5	27.9	28.0	28.3	28.8	27.4	27.7	27.8	28.2	28.6
Variations with the observer position at spacings:										
S = 1.0H	+ 0.2 / - 0.3					+ 0.2 / - 0.3				
1.5H	+ 0.1 / - 0.2					+ 0.1 / - 0.2				
2.0H	+ 0.1 / - 0.2					+ 0.1 / - 0.2				

CIE Pub.117, 1181 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 0.6$)

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2022-11-28

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:8.967m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:221.0V I:0.1071A P:13.70W PF:0.5786 Freq:49.99Hz Lamp Flux:1181.27x1 lm		
NAME: VIBES-VISC-14W-927-36°	TYPE:Downlight	SERIAL No.:
SPEC.:2700K	DIM.: $\varnothing 77\text{mm} \times H39\text{mm} \times 2$	
MFR.: NEKO LIGHTING AG		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	78	70	66	78	70	66	77	70	65	61
0.80	86	79	74	86	78	74	84	78	73	69
1.00	92	85	80	91	84	80	89	85	79	74
1.25	97	90	85	96	89	85	94	88	84	79
1.50	100	94	89	99	93	89	96	92	88	82
2.00	104	99	94	103	98	94	100	96	92	86
2.50	107	102	98	105	100	97	102	98	95	88
3.00	109	104	101	107	103	99	103	100	97	90
4.00	111	108	105	109	106	103	105	103	101	93
5.00	113	110	107	111	108	106	107	105	103	95
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 30.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:Jasoan
 Test Date:2022-11-28

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
 Humidity:58%
 Test Distance:8.967m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:221.0V I:0.1071A P:13.70W PF:0.5786 Freq:49.99Hz Lamp Flux:1181.27x1 lm		
NAME: VIBES-VISC-14W-927-36°	TYPE:Downlight	SERIAL No.:
SPEC.:2700K	DIM.: ϕ 77mm*H39mm*2	
MFR.: NEKO LIGHTING AG		

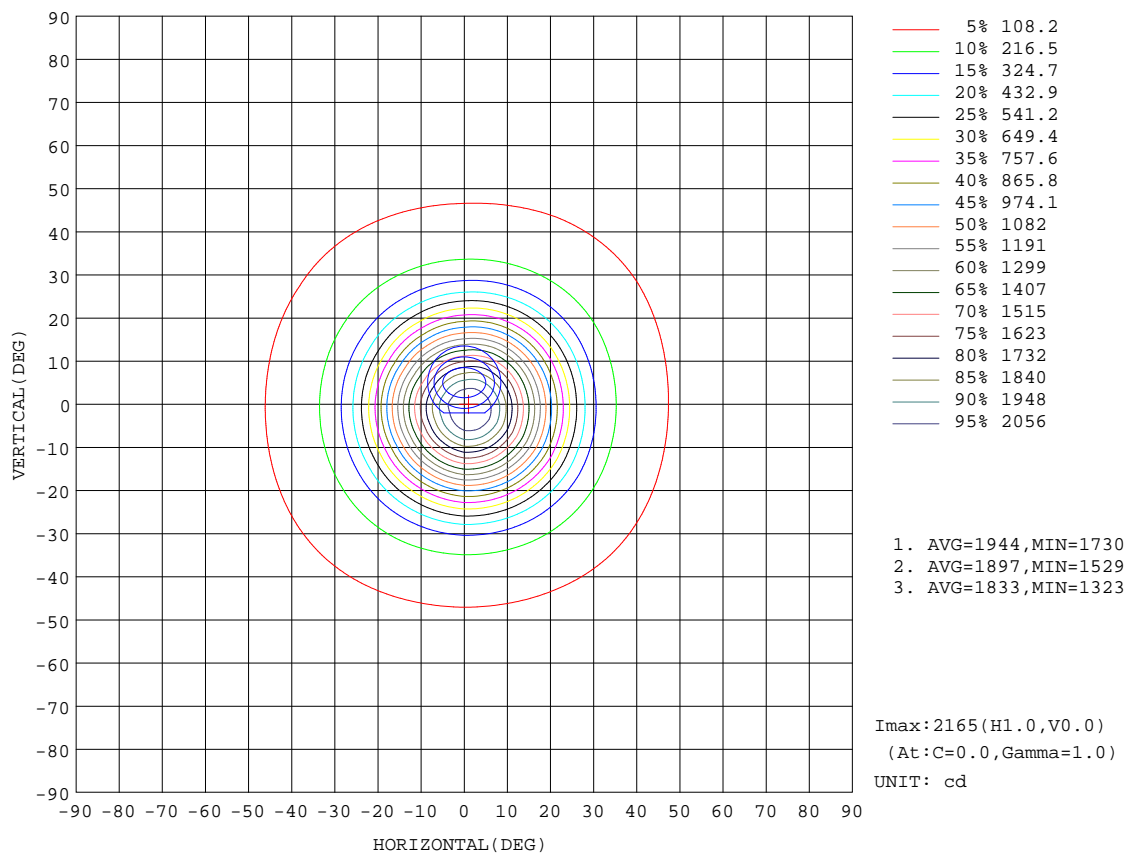


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2022-11-28

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:8.967m [K=1.0000]
Remarks:

AAI Figure

Test:U:221.0V I:0.1071A P:13.70W PF:0.5786 Freq:49.99Hz Lamp Flux:1181.27x1 lm		
NAME: VIBES-VISC-14W-927-36°	TYPE:Downlight	SERIAL No.:
SPEC.:2700K	DIM.: $\phi 77\text{mm} \times H39\text{mm} \times 2$	
MFR.: NEKO LIGHTING AG		

Flux out:472.4 lm

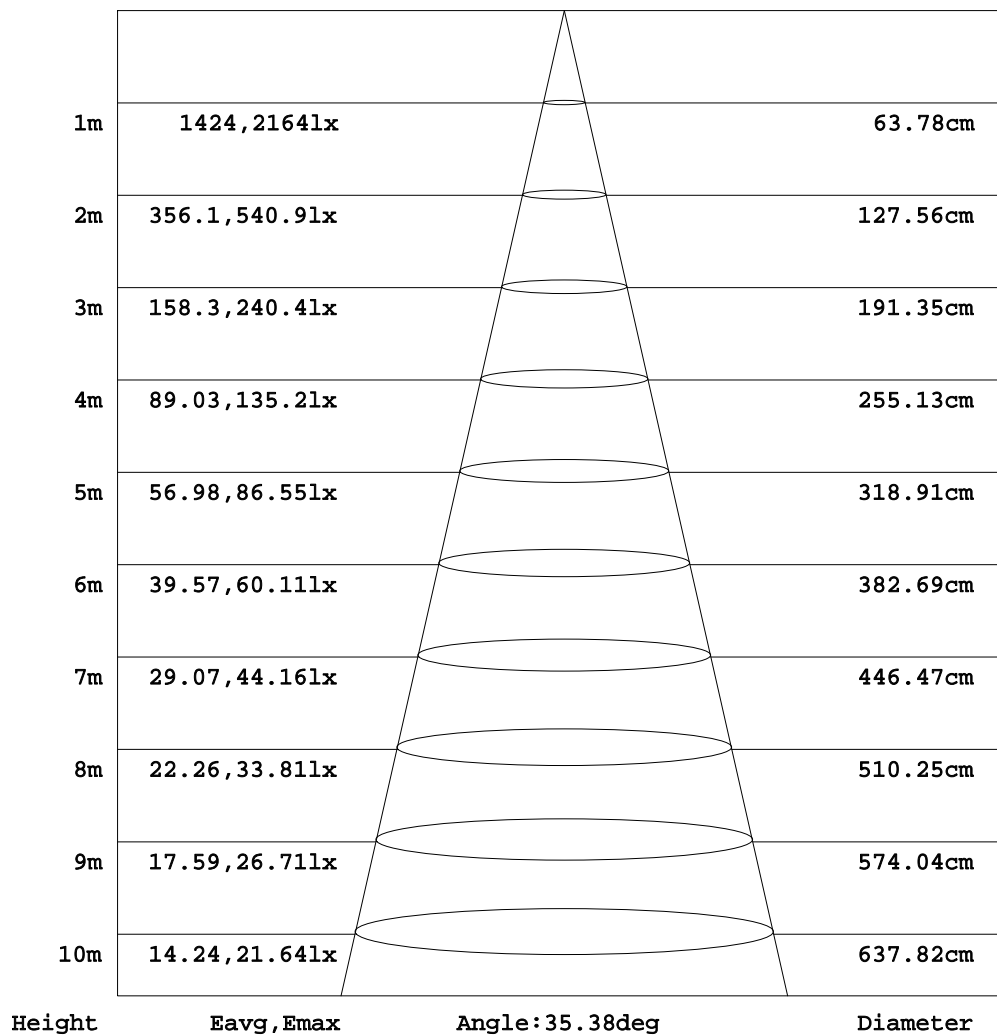


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2022-11-28

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:8.967m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:221.0V I:0.1071A P:13.70W PF:0.5786 Freq:49.99Hz Lamp Flux:1181.27x1 lm		
NAME: VIBES-VISC-14W-927-36°	TYPE:Downlight	SERIAL No.:
SPEC.:2700K	DIM.: $\phi 77\text{mm} \times H39\text{mm} \times 2$	
MFR.: NEKO LIGHTING AG		

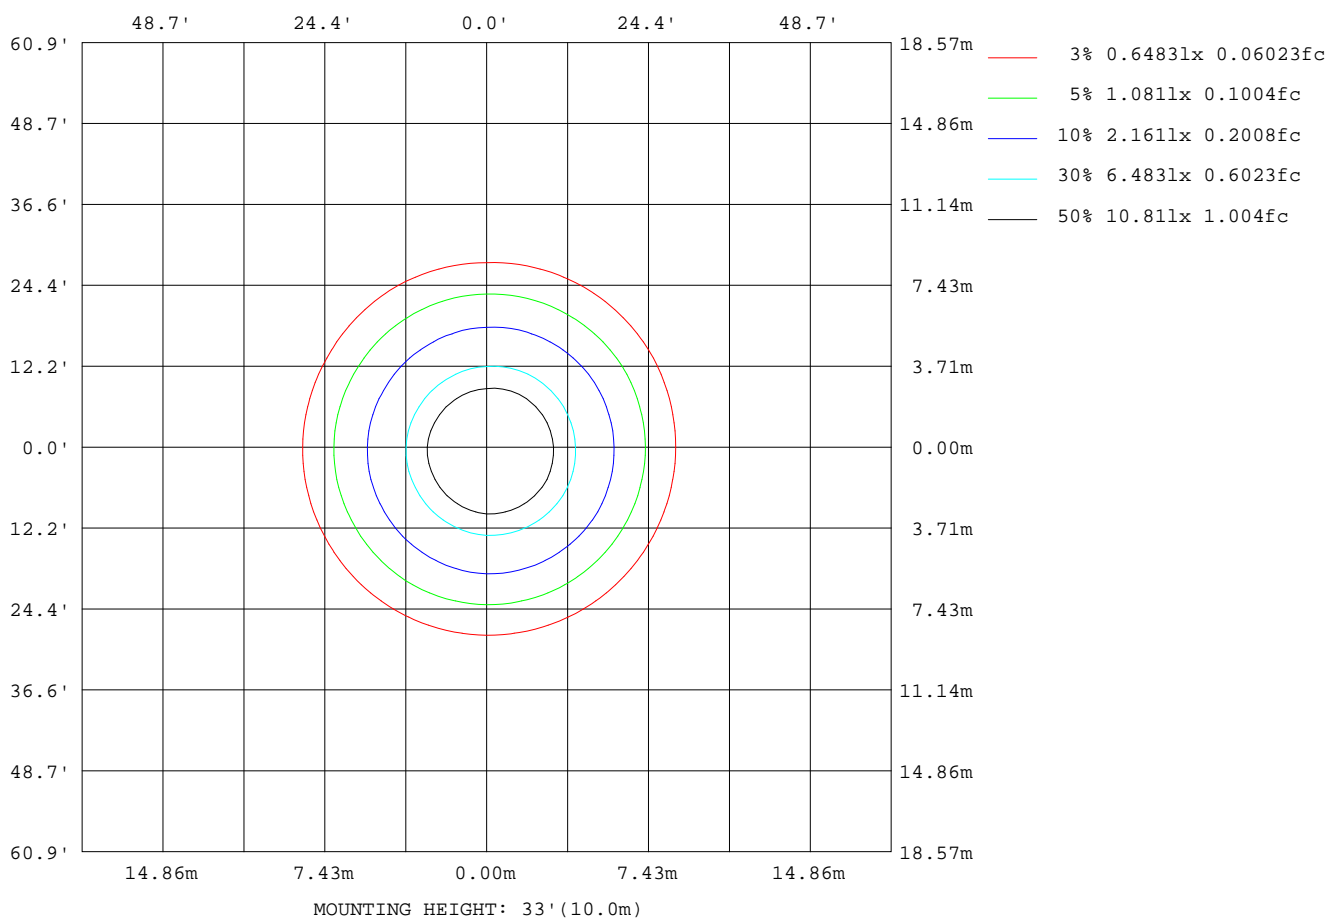

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Jasoan
Test Date: 2022-11-28

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity: 58%
Test Distance: 8.967m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:221.0V I:0.1071A P:13.70W PF:0.5786 Freq:49.99Hz Lamp Flux:1181.27x1 lm		
NAME: VIBES-VISC-14W-927-36°	TYPE:Downlight	SERIAL No.:
SPEC.:2700K	DIM.: ϕ 77mm*H39mm*2	
MFR.: NEKO LIGHTING AG		


AvgL	cd/m2
L_0~180 (65) av	37047
L_0~180 (75) av	35629
L_0~180 (85) av	28289
L_90~270 (65) av	37463
L_90~270 (75) av	35781
L_90~270 (85) av	27904
L_45 (65) av	37167
L_45 (75) av	35708
L_45 (85) av	27706

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:Jasoan
Test Date:2022-11-28

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:8.967m [K=1.0000]
Remarks:

Planar Illuminance Curve

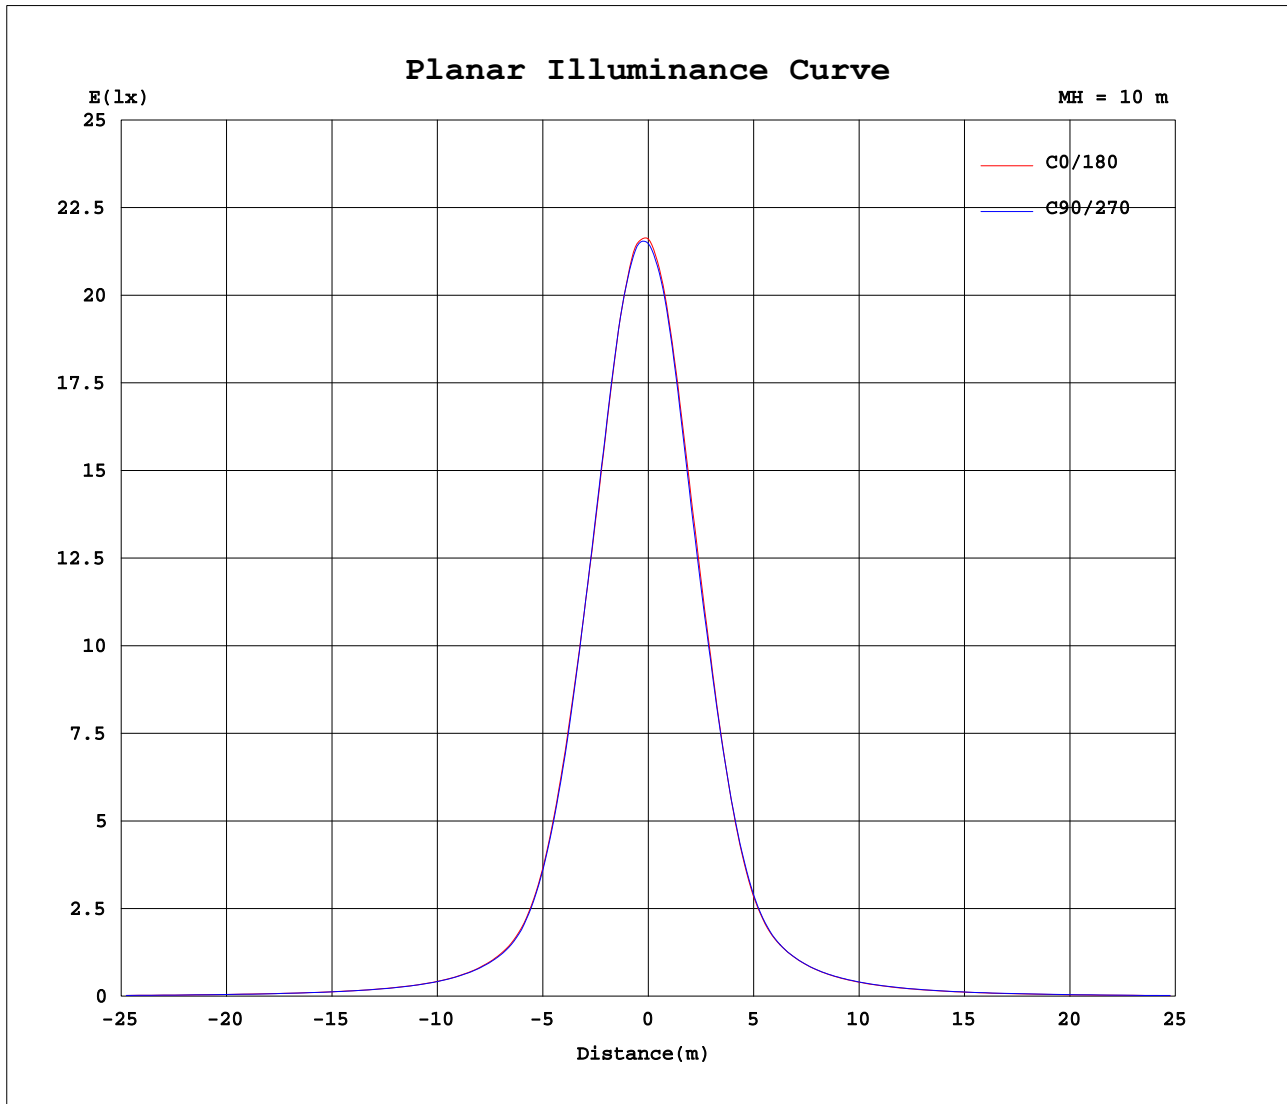

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: Jasoan
Test Date: 2022-11-28

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity: 58%
Test Distance: 8.967m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.362
Humidity:58%
Test Distance:8.967m [K=1.0000]
Remarks:

```